

BASF HP+ Wall E Series – Limit States

TER No. 1506-02

Issue Date: February 22, 2017

Updated: September 13, 2018

Subject to Renewal: January 1, 2020

BASF, Inc.

100 Park Avenue
Florham Park, NJ 07932
973-245-6000
basf.com

DIVISION: 06 00 00 – WOOD, PLASTICS, AND COMPOSITES

Section: 06 12 00 – Structural Panels
Section: 06 12 19 – Shear Wall Panels
Section: 06 16 00 – Sheathing

DIVISION: 07 00 00 – THERMAL AND MOISTURE PROTECTION

Section: 07 21 00 – Thermal Insulation
Section: 07 25 00 – Water-Resistive Barriers/Weather Barriers

1. Products Evaluated:

- 1.1. BASF HP+ Wall E Series utilizing WALLTITE® v.3 medium density Spray Polyurethane Foam (SPF) in combination with NEOPOR Expanded Polystyrene (EPS) Foam Plastic Insulating Sheathing (FPIS).
- 1.2. For the most recent version of this Technical Evaluation Report (TER), visit drjengineering.org. For more detailed state professional engineering and code compliance legal requirements and references, visit drjengineering.org/statelaw. DrJ is fully compliant with all state professional engineering and code compliance laws.
- 1.3. This TER can be used to obtain product approval in any country that is an IAF MLA Signatory (all countries found [here](#)) and covered by an [IAF MLA Evaluation](#) per the [Purpose of the MLA](#) (as an example, see [letter to ANSI](#) from the Standards Council of Canada). Manufacturers can go to jurisdictions in the U.S., Canada and other [IAF MLA Signatory Countries](#) and have their products readily approved by authorities having jurisdiction using [DrJ's ANSI accreditation](#).

DrJ is a Professional Engineering Approved Source

 **Learn more about DrJ's Accreditation**

- DrJ is an ISO/IEC 17065 accredited product certification body through ANSI Accreditation Services.
- DrJ provides certified evaluations that are signed and sealed by a P.E.
- DrJ's work is backed up by professional liability insurance.

Technical Evaluation Report (TER)

- 1.4. Building code regulations require that evaluation reports are provided by an approved agency meeting specific requirements, such as those found in [IBC Section 1703](#). Any agency accredited in accordance with ANSI ISO/IEC 17065 meets this requirement within ANSI's scope of accreditation. For a list of accredited agencies, visit ANSI's [website](#). For more information, see [drjcertification.org](#).
- 1.5. Requiring an evaluation report from a specific private company (i.e. ICC-ES, IAPMO, CCMC, DrJ, etc.) can be viewed as discriminatory and is a violation of international, federal, state, provincial and local anti-trust and free trade regulations.
- 1.6. DrJ's code compliance work:
 - 1.6.1. Conforms to code language adopted into law by individual states and any relevant consensus based standard such as an ANSI or ASTM standard.
 - 1.6.2. Complies with accepted engineering practice, all professional engineering laws and by providing an engineer's seal DrJ takes professional responsibility for its specified scope of work.

2. Applicable Codes and Standards:¹

- 2.1. *2015 National Building Code of Canada (NBC)*
- 2.2. *ASTM C518 – Standard Test Method for Steady-State Thermal Transmission Properties by Means of the Heat Flow Meter Apparatus*
- 2.3. *ASTM D1622 – Standard Test Method for Apparent Density of Rigid Cellular Plastics*
- 2.4. *ASTM D1623 – Standard Test Method for Tensile and Tensile Adhesion Properties of Rigid Cellular Plastics*
- 2.5. *ASTM D2126 – Standard Test Method for Response of Rigid Cellular Plastics to Thermal and Humid Aging*
- 2.6. *ASTM D2842 – Standard Test Method for Water Absorption of Rigid Cellular Plastics*
- 2.7. *ASTM D6226 – Standard Test Method for Open Cell Content of Rigid Cellular Plastics*
- 2.8. *ASTM E72 – Standard Test Methods of Conducting Strength Tests of Panels for Building Construction*
- 2.9. *ASTM E96 – Standard Test Methods for Water Vapor Transmission of Materials*
- 2.10. *ASTM E283 – Standard Test Method for Determining Rate of Air Leakage Through Exterior Windows, Curtain Walls, and Doors Under Specified Pressure Differences Across the Specimen*
- 2.11. *ASTM E330 – Standard Test Method for Structural Performance of Exterior Windows, Doors, Skylights and Curtain Walls by Uniform Static Air Pressure Difference*
- 2.12. *ASTM E564 – Standard Practice for Static Load Test for Shear Resistance of Framed Walls for Buildings*
- 2.13. *ASTM E2126 – Standard Test Methods for Cyclic (Reversed) Load Test for Shear Resistance of Vertical Elements of the Lateral Force Resisting Systems for Buildings*
- 2.14. *ASTM E2178 – Standard Test Method for Air Permeance of Building Materials*
- 2.15. *CAN/CSA O86-14 Engineering design in wood*
- 2.16. *CAN/ULC-S102 – Standard Method of Test for Surface Burning Characteristics of Building Materials and Assemblies*
- 2.17. *CAN/ULC S102.2 – Standard Method of Test for Surface Burning Characteristics of Flooring, Floor Coverings, and Miscellaneous Materials and Assemblies*
- 2.18. *CAN/ULC-S127 – Standard Corner Wall Method of Test for Flammability Characteristics of Non-Melting Foam Plastic Building Materials*
- 2.19. *CAN/ULC S701 – Thermal Insulation, Polystyrene, Boards and Pipe Covering*
- 2.20. *CAN/ULC-S705.1 – Standard for Thermal Insulation - Spray Applied Rigid Polyurethane Foam, Medium Density - Material Specification*

¹ Unless otherwise noted, code references are to the 2015 version of the NBC. This product is also approved for use with the 2005 and 2010 NBC and the standards referenced therein.

Technical Evaluation Report (TER)

2.21. *CAN/ULC-S705.2 – Standard for Thermal Insulation - Spray Applied Rigid Polyurethane Foam, Medium Density – Application*

2.22. *Engineering Guide for Wood Frame Construction, Canadian Wood Council (CWC)*

3. Performance Evaluation:

3.1. BASF HP+ Wall E Series was evaluated to determine:

3.1.1. Structural performance under lateral load conditions in accordance with:

3.1.1.1. *NBC Division B Subsection 9.23.13 Bracing to Resist Lateral Loads Due to Wind and Earthquake*

3.1.1.2. *NBC Section 4.1 Structural Loads and Procedures and the CWC Engineering Guide for Wood Frame Construction.*

3.1.2. Structural performance under uplift and gravity loads for use with single top plates in accordance with *NBC Division B Article 9.23.11.3.*

3.1.3. Structural performance under transverse load conditions for use to resist factored external wind loads in accordance with *NBC Division B Subsection 9.23.13.*

3.1.4. Continuous insulating sheathing requirements complying with the provisions of *NBC Division B Part 5 and Subsection 9.25.2.*

3.1.5. Performance for use as a component of the air barrier system in accordance with *NBC Division B Section 5.4 and subsection 9.25.3.*

3.1.6. Flame-spread rating and smoke developed classification complying with the provisions of *NBC Division B Subsection 3.1.12. and article 9.10.3.2.*

3.2. Performance of BASF HP+ Wall E Series or any of its component materials for use as a water-resistive barrier (WRB) assembly or WRB material is outside the scope of this evaluation.

3.3. Performance of BASF HP+ Wall E Series or any of its component materials as used in the normal construction process is outside the scope of this TER.

3.3.1. The term normal construction process includes storage, weather conditions, durability considerations, handling, installing, restraining and bracing of BASF HP+ Wall E Series through the shipping, storing and construction means and methods process.

3.4. Use of BASF HP+ Wall E Series in a portal frame is outside the scope of this evaluation.

3.5. All other code compliance assessments or evaluations are outside the scope of this TER. Consult the manufacturer for other code compliance issues.

4. Product Description and Materials:

4.1. BASF HP+ Wall E Series is a proprietary wall system consisting of WALLTITE® v.3 Spray Polyurethane Foam (SPF) combined with NEOPOR® Foam Plastic Insulating Sheathing (FPIS).

4.1.1. The BASF HP+ Wall E Series described in this Technical Evaluation Report (TER) contains a combination of the following materials:

4.1.1.1. WALLTITE® v.3 SPF-25 mm (1") or 38 mm (1½")

4.1.1.2. NEOPOR® FPIS-16 mm (5⁄8"), 29 mm (1¹⁄₈") or 57 mm (2¼")

4.1.1.2.1. Minimum 3.3 mm (0.131") x 60 mm (2³⁄₈") nail with a minimum of 31 mm (1.25") penetration into framing. Fastener spacing 6" at perimeter and 12" in the field.

4.1.1.3. 2x Wood Framing

4.1.1.3.1. 2x4 studs – minimum stud grade SPF or greater.

4.1.1.3.2. Each stud fastened to top and bottom plates with minimum three (3) 3.3 mm (0.131") x 83 mm (3.25") nails.

4.1.1.3.3. 2x4 top (single or double) and bottom plates – minimum #2 SPF or greater.

Technical Evaluation Report (TER)

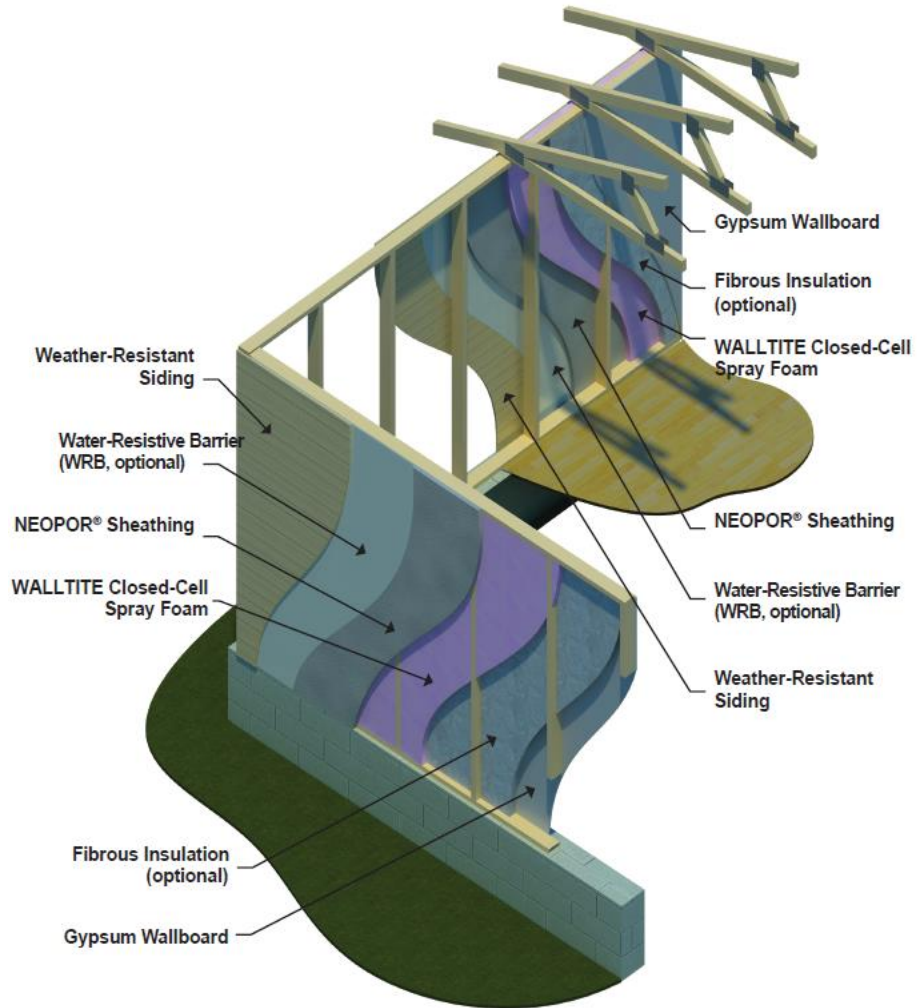


Figure 1a: Illustration of BASF HP+ Wall E Series

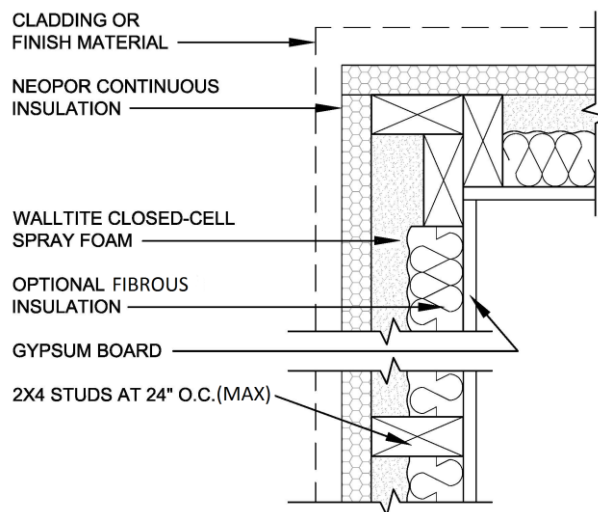


Figure 1b: Cross Section of BASF HP+ Wall E Series Layers

Technical Evaluation Report (TER)

5. Applications:

5.1. General

- 5.1.1. BASF HP+ Wall E Series are used in buildings constructed in accordance with *NBC Division B Section 9.23* for wood frame construction. BASF HP+ Wall E Series is used to provide:
 - 5.1.1.1. Lateral load resistance (wind and seismic) for braced HP+ Wall E Series panels used in wood frame construction.
 - 5.1.1.2. Transverse load resistance (positive and negative wind pressure) for braced HP+ Wall E Series panels used in wood frame construction.
 - 5.1.1.3. Resistance to uplift and gravity loads in single top plate applications for HP+ Wall E Series assemblies used in wood frame construction in accordance with *NBC Division B Article 9.23.11.3*.
- 5.1.2. BASF HP+ Wall E Series is used to provide thermal resistance in the exterior wall component of the building thermal envelope in accordance with *NBC Division B Subsections 5.3.1 and 9.25.2*.
- 5.1.3. BASF HP+ Wall E Series is used to provide resistance to air leakage in the exterior wall component of the building envelope in accordance with *NBC Division B Subsections 5.4.1 and 9.25.3*.
- 5.1.4. BASF HP+ Wall E Series may be used in buildings designed in accordance with *NBC Division B Section 4.1 Structural Loads and Procedures* or the *CWC Engineering Guide for Wood Frame Construction*.

5.2. Structural Applications

5.2.1. General Structural Provisions

- 5.2.1.1. Except as otherwise described in this TER, BASF HP+ Wall E Series shall be installed in accordance with the applicable building codes listed in [Section 2](#) using the provisions set forth therein for the design and installation of wood structural panels (WSP) and with this TER.
- 5.2.1.2. BASF HP+ Wall E Series are permitted to be designed in accordance with *NBC Division B Part 9 Articles 9.23.13.1, 9.23.13.2 and 9.23.13.3* for the design of lateral-load-resisting systems using the methods and conditions set forth therein for equivalence to the sheathing requirements in Tables 9.23.13.6 and 9.23.17.2.A as follows:
 - 5.2.1.2.1. Equivalent to 12.5 mm (0.5") sheathing fastened at a maximum of 150 mm (6") o. c. at edges and 300 mm (12") o.c. along intermediate supports using a minimum 3.3 mm (0.131") diameter fastener having a penetration of at least 38 mm (1.5"), on framing spaced a maximum of 600 mm (24") o.c.
- 5.2.1.3. BASF HP+ Wall E Series are permitted to be designed in accordance with *Engineering Guide for Wood Frame Construction, Section 10* for the design of lateral-load-resisting systems using the methods and conditions set forth therein for equivalence to Table 10.2.10A or CAN/CSA O86 Table 9.5.1A as follows:
 - 5.2.1.3.1. Equivalent to 12.5 mm (0.5") sheathing fastened at a maximum of 150 mm (6") o. c. at edges and 300 mm (12") o.c. along intermediate supports using a minimum 3.3 mm (0.131") diameter fastener having a penetration of at least 38 mm (1.5"), on framing spaced a maximum of 600 mm (24") o.c.
- 5.2.1.4. Anchorage for in-plane shear shall be provided to transfer the induced shear force into and out of each shear wall in accordance with *NBC Division B Subsection 9.23.6*.
 - 5.2.1.4.1. For buildings with two or more floors supported by frame walls that are in areas where the seismic spectral response acceleration, $S_a(0.2)$, is not greater than 0.70 or where the 1-in-50 hourly wind pressure is equal to or greater than 0.80 kPa (16.7 psf) but not greater than 1.20 kPa (25 psf), two anchor bolts per braced wall panel are required.
 - 5.2.1.4.1.1. Anchor bolt diameter shall not be less than 15.9 mm (0.625"), located within 0.5 m (19.75") of the end of the foundation and spaced not more than 2.4 m (7'-10") o.c. or
 - 5.2.1.4.1.2. Anchor bolt diameter shall not be less than 12.7 mm (0.5"), located within 0.5 m (19.75") of the end of the foundation and spaced not more than 1.7 m (5'-7") o.c.

Technical Evaluation Report (TER)

- 5.2.1.4.2. For buildings supported by frame walls that are in areas where the seismic spectral response acceleration, $S_a(0.2)$, is greater than 0.70 but not greater than 1.8 and the 1-in-50 hourly wind pressure is not greater than 1.20 kPa (25 psf), two anchor bolts per braced wall panel are required and spaced in accordance with Table 9.23.6.1.
 - 5.2.1.4.3. Where the seismic spectral response acceleration, $S_a(0.2)$, is greater than 1.8 or the 1-in-50 hourly wind pressure is equal to or greater than 1.2 kPa (25 psf), anchorage shall be designed according to Part 4.
 - 5.2.1.5. The maximum aspect ratio for full height BASF HP+ Wall E Series braced wall segments shall be 4:1.
 - 5.2.1.6. The minimum full height panel width shall be 600 mm (24"). Panels may be installed vertically or horizontally.
 - 5.2.1.7. All NEOPOR® panel edges shall be supported with a minimum 38 mm (1.5") framing member. Abutting panel edges shall be generally centered on the framing member.
 - 5.2.1.8. Installation is permitted for single top plate or double top plate applications in accordance with *NBC* Division B Article 9.23.11.3 where concentrated loads from ceilings, floors and roofs are not more than 50 mm (2") to one side of the studs.
 - 5.2.1.9. Where the application exceeds the limitations set forth herein, design shall be permitted in accordance with accepted engineering procedures, experience, and technical judgment.
- 5.2.2. Acceptable Solutions in accordance with *NBC* Division B Part 9 Bracing Applications**
- 5.2.2.1. BASF HP+ Wall E Series may be used to brace walls of buildings as an equivalent to OSB, O-2 Grade in accordance with *NBC* Division B Table 9.23.17.2.-A Wall Sheathing Thickness and Specifications:
 - 5.2.2.1.1. Supports 400 mm (16") o.c. – 6.0 mm (0.24") minimum sheathing thickness
 - 5.2.2.1.2. Supports 600 mm (24") o.c. – 7.5 mm (0.3") minimum sheathing thickness
 - 5.2.2.2. Where a building, or portion thereof, does not comply with one or more of the bracing requirements within the acceptable solutions of *NBC* Part 9, those portions shall be designed and constructed in accordance with *NBC* Division B Part 4 Structural Loads and Procedures or the *CWC Engineering Guide for Wood Frame Construction* in accordance with *NBC* Division B Sentence 9.23.13.1.2(b)(ii or iii) as follows:
 - 5.2.2.2.1. As an equivalent to OSB, O-1 or O-2 Grades in *NBC* Division B Table 9.23.13.6: supports 400 mm (16") o.c. – 11 mm (0.433") minimum sheathing thickness with fasteners spaced 150 mm (6") o.c. at edges and 300 mm (12") o.c. in field using a 3.7 mm (0.145") diameter fastener having a penetration of at least 40 mm (1.6").
 - 5.2.2.2.2. As an equivalent to OSB, O-1 or O-2 Grades in *NBC* Division B Table 9.23.13.6: supports 600 mm (24") o.c. – 12.5 mm (0.5") minimum sheathing thickness with fasteners spaced 150 mm (6") o.c. at edges and 300 mm (12") o.c. in field using a 3.3 mm (0.131") diameter fastener having a penetration of at least 38 mm (1.5").
 - 5.2.2.2.3. Or using the design values given in [Table 1](#).

Technical Evaluation Report (TER)

BASF HP+ Wall E System Design Values	BASF HP+ Wall E Series Specified Shear Capacity for Limit States Design – Wind or Seismic ^{1,2}					
	Maximum Stud Spacing o.c., mm (in)	Interior Gypsum Board Minimum Thickness, mm (in)	Maximum Gypsum Board Fastener Spacing edge/field, mm (in)	Specified Shear Strength, kN/m (plf)	Ductility Factor R _d	Overstrength Factor, R _o
BASF 16 mm (0.625") NEOPOR® + 38 mm (1.5") SPF	600 (24)	15.9 (0.625)	300/600 (12/24)	4.6 (320)	N/A	N/A
BASF 29 mm (1.125") NEOPOR® + 25 mm (1") SPF	600 (24)	15.9 (0.625)	300/600 (12/24)	4.0 (270)		
BASF 29 mm (1.125") NEOPOR® + 38 mm (1.5") SPF	600 (24)	15.9 (0.625)	300/600 (12/24)	4.8 (330)	3.0	1.7
BASF 57 mm (2.25") NEOPOR® + 38 mm (1.5") SPF	600 (24)	15.9 (0.625)	300/600 (12/24)	5.7 (390)		

For SI: 1" = 25.4 mm 1 lb/ft = 0.0146 kN/m
 1. BASF HP+ Wall E Series fastening per Section 6.
 2. Interior gypsum wall board attached to framing with minimum 2.14 mm (0.086") nail or #6 Type W screws. Minimum penetration of nails or screws into framing is 19 mm (¾"). Fastener spacing shall be as required above.
 Note: NBC Table 9.23.13.6 requires 15.9 mm (5/8") thick gypsum with framing 600 mm (24") o.c.

Table 1: Specified Shear Design Values for BASF HP+ Wall E Series – Wind or Seismic

5.3. Axial loading

- 5.3.1. BASF HP+ Wall E Series will perform the same as prescriptive wall assemblies.
- 5.3.2. Designs shall have a load path capable of transferring loads from their point of origin to their final point of resistance in accordance with NBC Division C Sentence 2.2.4.3(1).

5.4. Transverse Wind Loading

- 5.4.1. BASF HP+ Wall E Series installed over exterior framing spaced a maximum of 600 mm (24") o.c. without an interior covering can resist allowable wind loads as shown in [Table 2](#). Hourly wind pressures (1-in-50) to be resisted are found in NBC Division B, Appendix C, Table C-2, for selected locations.

Summary of Transverse Load Capacity of BASF HP+ Wall E Series			
SPF & Sheathing Material (Minimum)	Transverse Wind Load Resistance		Hourly 1-in-50 Wind Pressure kPa (psf)
	Negative	Positive	
	Specified Average Pressure kPa (psf)	Specified Average Pressure kPa (psf)	Maximum 600 mm (24") o.c. Framing
29 mm (1.125") NEOPOR® + 38 mm (1.5") SPF	3.2 (67)	3.1 (65)	3.1 (65)

For SI: 1" = 25.4 mm 1 psf= 0.04788 kPa
 1. Hourly Wind Pressure (1-in-50) for selected locations can be located in NBC Division B, Appendix C, Table C-2
 Note: The attachment of the sheathing to the framing is primarily through the adhesion of the SPF to the framing and NEOPOR® sheathing.

Table 2: Summary of Transverse Load Capacity of BASF HP+ Wall E Series

5.5. Thermal Resistance

- 5.5.1. BASF HP+ Wall E Series complies with the continuity of insulation requirements of NBC Division B Article 9.36.2.5.
- 5.5.2. BASF HP+ Wall E Series assemblies have the nominal thermal resistance as shown in [Table 3](#).

Technical Evaluation Report (TER)

BASF HP+ Wall E Series RSI/R-Values	
SPF & Sheathing Materials	RSI/R-Value, m ² K/W (h·ft ² ·°F/Btu)
BASF 16 mm (5/8") NEOPOR® + 38 mm (1-1/2") SPF	2.2 (12.4)
BASF 29 mm (1-1/8") NEOPOR® + 38 mm (1-1/2") SPF	2.6 (14.6)
For SI: 1 m ² K/W = 5.678 hr·ft ² ·°F/Btu	

Table 3: BASF HP+ Wall E Series Thermal Resistance Properties

5.6. Air Barrier Compliance

- 5.6.1. BASF HP+ Wall E Series components have the air permeance performance material properties shown in [Table 4](#) in accordance with *NBC* Division B Article 5.4.1.2 and Subsection 9.25.3.

Air Permeance Performance of BASF HP+ Wall E Series Components	
Component	Air Permeance
WALLTITE® v.3	≤ 0.02 l/s/m ² @ 75 Pa
1. Tested in accordance with the Technical Guide for Air Barrier Systems for Exterior Walls of Low-Rise Buildings. CCMC Evaluation Report 13659-R	

Table 4: BASF HP+ Wall E Series Air Permeance Performance

5.7. Thermal Barrier Requirements

- 5.7.1. Foam plastics that form part of a wall or ceiling assembly in combustible construction shall be protected from adjacent spaces in the building, other than adjacent concealed spaces within attic or roof spaces, crawl spaces, and wall and ceiling assemblies by an approved thermal barrier as required by *NBC* Division B Article 3.1.4.2 and 9.10.17.10.

5.8. Material Fire Properties

- 5.8.1. Surface Burning Characteristics

- 5.8.1.1. BASF HP+ Wall E Series panels have the flame spread characteristics shown in [Table 5](#).

Flame Spread Rating of WALLTITE® v.3	
WALLTITE® v.3	<500
1. Tested in accordance with <i>CAN/ULC-S102</i> including <i>CAN/ULC-S127</i> .	

Table 5: Flame Spread Rating of WALLTITE® v.3

6. Installation:

6.1. General

- 6.1.1. BASF HP+ Wall E Series shall be installed in accordance with the manufacturer's published installation instructions and this TER.
- 6.1.2. WALLTITE v.3 must be installed in accordance with standard *CAN/ULC-S705.2*, CCMC listing 13588-L, and BASF Canada's Quality Assurance and Training Program (QATP) manual by installers licensed through the QATP and certified by Morrison Hershfield (MH).
- 6.1.3. A copy of the manufacturer's published installation instructions shall be available at all times on the jobsite during installation.
- 6.1.4. Installation shall comply with the manufacturer's installation instructions and this TER. In the event of a conflict between the manufacturer's installation instructions and this TER, the more restrictive shall govern.
- 6.1.5. Where required, gypsum wallboard shall be a minimum 12.7 mm (0.5") thickness.

Technical Evaluation Report (TER)

6.2. Orientation

- 6.2.1. BASF HP+ Wall E Series sheathing panels must be installed vertically with the length dimension of the panels parallel to the framing behind and all panel edges supported by framing or blocking.
- 6.2.2. BASF HP+ Wall E Series sheathing panels must be installed over studs, with framing that has a thickness of not less than 38 mm (1.5") and spaced a maximum of 600 mm (24") o.c.

6.3. Fasteners

6.3.1. NEOPOR® Foam Plastic Insulating Sheathing

- 6.3.1.1. Minimum 3.3 mm (0.131") x 60 mm (2³/₈") nail with a minimum of 31 mm (1.25") penetration into framing. Fastener spacing 6" at perimeter and 12" in the field.

6.3.2. Gypsum Wallboard

- 6.3.2.1. Where required, gypsum wallboard shall be installed in accordance with *NBC* Division B Article 9.29.5 except No. 6 x 32 mm (1¹/₄") Type W or S wood screw, or equivalent is permitted where a fire-resistance rating is not required.

6.4. Fastener Spacing

6.4.1. NEOPOR® Foam Plastic Insulating Sheathing

- 6.4.1.1. Maximum of 150 mm o.c. (6") along the edge and 300 mm (12") o.c. in the field.

6.5. Gypsum Wallboard

- 6.5.1.1. For *NBC* Division B Part 9 applications, gypsum nail fasteners shall be spaced a maximum of 150 mm (6") o.c. on vertical wall supports and 300 mm (12") o.c. along intermediate supports.
- 6.5.1.2. For *NBC* Division B Part 9 applications, gypsum screw fasteners shall be spaced a maximum of 150 mm (6") o.c. on vertical wall supports and 300 mm (12") o.c. along intermediate supports.

- 6.5.2. For engineered design, see [Table 1](#).

6.6. Fastener Edge Distance

- 6.6.1. For *NBC* Division B Part 9 applications, fastener edge distance is a minimum of 10 mm (³/₈") for both BASF HP+ Wall E Series and gypsum in accordance with Division B, Article 9.29.5.8.

7. Test and Engineering Substantiating Data:

- 7.1. Lateral load testing conducted by Structural Building Components Research Institute (SBCRI), based on *ASTM E2126*.
- 7.2. Transverse wind load testing conducted by SBCRI, based on *ASTM E330*.
- 7.3. Uplift load testing conducted by SBCRI, based on *ASTM E72*.
- 7.4. Gravity load testing for single top plate applications conducted by SBCRI, based on *ASTM E72*.
- 7.5. Surface burning testing conducted by:
 - 7.5.1. Underwriters' Laboratories of Canada, based on CAN/ULC-S102.2 for NEOPOR® FPIS, and
 - 7.5.2. Exova Canada, based on CAN/ULC-S102 for WALLTITE SPF.
- 7.6. Material property testing conducted by:
 - 7.6.1. QAI Laboratories, based on *CAN/ULC-S701* for NEOPOR® FPIS, and
 - 7.6.2. Exova Canada, based on *CAN/ULC-S705.1* for WALLTITE SPF.
- 7.7. WALLTITE® v.3 product listing per CCMC 13588-L.
- 7.8. The product(s) evaluated by this TER fall within the scope of one or more of the model, state or local building codes for building construction. The testing and/or substantiating data used in this TER is limited to buildings, structures, building elements, construction materials and civil engineering related specifically to buildings.
- 7.9. The provisions of model, state or local building codes for building construction do not intend to prevent the installation of any material or to prohibit any design or method of construction. Alternatives shall use consensus

Technical Evaluation Report (TER)

standards, performance-based design methods or other engineering mechanics based means of compliance. This TER assesses compliance with defined standards, accepted engineering analysis, performance-based design methods, etc. in the context of the pertinent building code requirements.

- 7.10. Some information contained herein is the result of testing and/or data analysis by other sources, which DrJ relies on to be accurate, as it undertakes its engineering analysis.
- 7.11. DrJ has reviewed and found the data provided by other professional sources are credible. The information in this TER conforms with DrJ's procedure for acceptance of data from approved sources.
- 7.12. DrJ's responsibility for data provided by approved sources is in accordance with professional engineering law.
- 7.13. Where appropriate, DrJ relies on the derivation of design values, which have been codified into law through the codes and standards (e.g., *NBC*, *CAN/CSA O86*, etc.). This includes review of code provisions and any related test data that helps with comparative analysis or provides support for equivalency to an intended end-use application. Where the accuracy of design values provided herein is reliant upon the published properties of commodity materials (e.g. lumber, steel, concrete, etc), DrJ relies upon grade/properties provided by the raw material supplier to be accurate and conforming to the mechanical properties defined in the relevant material standard.

8. Findings:

- 8.1. When installed in accordance with the manufacturer's installation instructions and this TER, BASF HP+ Wall E Series complies with, or is a suitable alternative to, the applicable sections of the codes listed in [Section 2](#) for the following applications.
 - 8.1.1. Lateral load resistance due to wind and seismic loads carried by shear walls in accordance with [Table 1](#).
 - 8.1.2. Transverse wind load resistance in accordance with [Table 2](#).
 - 8.1.3. Thermal resistance properties in accordance with [Table 3](#).
 - 8.1.4. Air permeance performance in accordance with [Table 4](#).
 - 8.1.5. Material fire properties in accordance with [Table 5](#).
- 8.2. *NBC* Division A, Article 1.2.1.1 states:
 - 1.2.1 Compliance with this Code**
 - 1) Compliance with this Code shall be achieved by
 - a) complying with the applicable acceptable solutions in Division B (see Appendix A), or
 - b) using alternative solutions that will achieve at least the minimum level of performance required by Division B in the areas defined by the objectives and functional statements attributed to the applicable acceptable solutions (see Appendix A).
 - 2) For the purposes of compliance with this Code as required in Clause 1.2.1.1.(1)(b), the objectives and functional statements attributed to the acceptable solutions in Division B shall be the objectives and functional statements referred to in Subsection 1.1.2. of Division B.
- 8.3. *NBC* Division C, Article 2.3 includes additional guidance for Alternative Solutions.
- 8.4. This product has been evaluated with the codes listed in [Section 2](#), and is compliant with all known provincial and local building codes. Where there are known variations in provincial or local codes that are applicable to this evaluation, they are listed here:
 - 8.4.1. No known variations
- 8.5. This TER uses professional engineering law, the building code, ANSI/ASTM consensus standards and generally accepted engineering practice as its criteria for all testing and engineering analysis. DrJ's professional engineering work falls under the jurisdiction of each state Board of Professional Engineers, when signed and sealed.

9. Conditions of Use:

- 9.1. Where required by the Authority Having Jurisdiction (AHJ) in which the project is to be constructed, this report and the installation instructions shall be submitted at the time of permit application.
- 9.2. Any generally accepted engineering calculations needed to show compliance with this TER shall be submitted to the code official for review and approval.

Technical Evaluation Report (TER)

- 9.3. Design loads shall be determined in accordance with the building code adopted by the jurisdiction in which the project is to be constructed and/or by the Building Designer (e.g., Owner, Registered Design Professional, etc.).
- 9.4. When BASF HP+ Wall E Series are not installed for use as wall bracing, as described in this TER, the walls shall be braced by other materials, in accordance with the applicable code.
- 9.5. Loads applied shall not exceed those recommended by the manufacturer as follows:
 - 9.5.1. Allowable shear loads do not exceed values in [Table 1](#), as applicable.
 - 9.5.2. Allowable axial loads do not exceed values in [Section 5.3](#).
 - 9.5.3. Allowable transverse loads do not exceed values in [Table 2](#).
- 9.6. The manufacturer's installation instructions shall be available on the jobsite for inspection.
- 9.7. NEOPOR® panel edges shall be supported by wall framing or solid blocking with a minimum thickness of 38 mm (1.5").
- 9.8. NEOPOR® beads used to produce the FPIS are manufactured in Ludwigshafen, Germany, under a quality assurance program with inspections by QAI Laboratories.
- 9.9. The BASF SPF insulation components are manufactured in Toronto, Ontario, and Blackie, Alberta, Canada under a quality control program. The Toronto plant is ISO 9001:2008 certified.
- 9.10. Design
 - 9.10.1. Building Designer Responsibility
 - 9.10.1.1. Unless the AHJ allows otherwise, the Construction Documents shall be prepared by a Building Designer (e.g., Owner, Registered Design Professional, etc.) for the Building and shall be in accordance with *NBC* Division C Sentence 2.2.4.3(1).
 - 9.10.1.2. The Construction Documents shall be accurate and reliable and shall provide the location, direction and magnitude of all applied loads and shall be in accordance with *NBC* Division C Sentence 2.2.4.3(1) and Appendix Note A-2.2.6.2.(1).
 - 9.10.2. Construction Documents
 - 9.10.2.1. Construction Documents shall be submitted to the AHJ or Building Official for approval and shall contain the plans, specifications and details needed for the AHJ or Building Official to approve such documents.
- 9.11. Responsibilities
 - 9.11.1. The information contained herein is a product, material, detail, design and/or application TER evaluated in accordance with the referenced building codes, testing and/or analysis through the use of accepted engineering practice, experience and technical judgment.
 - 9.11.2. DrJ TERs provide an assessment of only those attributes specifically addressed in the Products Evaluated or Code Compliance Process Evaluated sections.
 - 9.11.3. The engineering evaluation was performed on the dates provided in this TER, within DrJ's professional scope of work.
 - 9.11.4. The actual design, suitability and use of this TER, for any particular building, is the responsibility of the Owner or the Owner's authorized agent, and the TER shall be reviewed for code compliance by the Building Official.
 - 9.11.5. The use of this TER is dependent on the manufacturer's in-plant QC, the ISO/IEC 17020 third-party quality assurance program and procedures, proper installation per the manufacturer's instructions, the Building Official's inspection and any other code requirements that may apply to demonstrate and verify compliance with the applicable building code.

Technical Evaluation Report (TER)

10. Identification:

- 10.1. Each NEOPOR® sheathing panel or package described in this TER is identified with information to confirm compliance with the applicable material standard or product listing.
- 10.2. BASF spray foam components are identified by a label on the containers bearing the manufacturer's name, product name, and other information to confirm code compliance with standard *CAN/ULC-S705.1*.
- 10.3. Additional technical information can be found at walltite.com.

11. Review Schedule:

- 11.1. This TER is subject to periodic review and revision. For the most recent version of this TER, visit drjengineering.org.
- 11.2. For information on the current status of this TER, contact [DrJ Engineering](#).



- [Mission and Professional Responsibilities](#)
- [Product Evaluation Policies](#)
- [Product Approval – Building Code, Administrative Law and P.E. Law](#)